







Installation manual

Guard Cond.

MOK-200GA (Guard Cond. Large)

Installation manual (1)	Guard Cond (2)	M4x12 Screws (12)
		

MOK-100GA (Guard Cond. Small)

Installation manual (1)	Guard Cond (1)	M4x12 Screws (6)
		


Applied model

Guard Cond	Outdoor Unit Size (W x H x D (mm))
MOK-200GA	Large Frame : 1295 x 1695 x 765
MOK-100GA	Small Frame : 880 x 1695 x 765

Assembly Work

MOK-200GA (Guard Cond. Large)

Large Frame

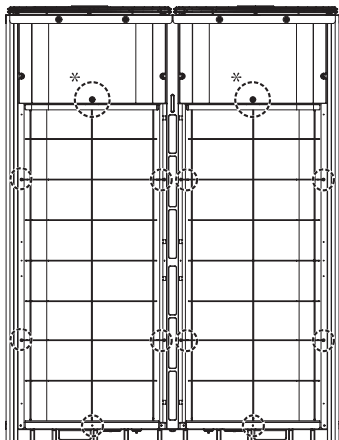


Place the Guard Cond considering the left and right sides, and fix it with screws at the place marked with circles.

For the screws marked with '*', since it is already tightened, you must untighten them and then tighten them back after placing the Guard Cond underneath the Cabinet.

MOK-100GA (Guard Cond. Small)

Small Frame

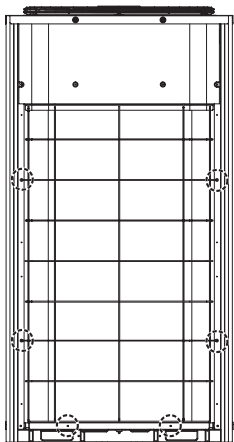

Place the Guard Cond and fix it with screws at the place marked with circles.



CAUTION

- Check if there's any vibration or noise from the parts after fixing the Guard Cond.
- Do not touch the heat exchanger. You may get injured by sharp edge of the heat exchanger or damage it which may cause performance decrease.